



INSTYTUT TECHNIKI BUDOWLANEJ

PL 00-611 WARSZAWA

ul. Filtrowa 1

tel.: (+48 22) 825-04-71

(+48 22) 579-62-94

eta@itb.pl

www.itb.pl



Member of



www.eota.eu

European Technical Assessment

**ETA-21/0823
of 01/02/2022**

General Part

Technical Assessment Body issuing the European Technical Assessment

Instytut Techniki Budowlanej

Trade name of the construction product

AISC, AISS, AISX, AISDC, AISDS, AISDX

Product family to which the construction product belongs

Nailed-in plastic anchors for fixing of external thermal insulation composite systems with rendering in concrete and masonry

Manufacturer

Index - Técnicas Expansivas S.L.
c/ Segador 13
26006 Logroño (La Rioja)
Spain

Manufacturing plant

Manufacturing plant no. 13

This European Technical Assessment contains

26 pages including 3 Annexes which form an integral part of this Assessment

This European Technical Assessment is issued in accordance with regulation (EU) No 305/2011, on the basis of

European Assessment Document EAD 330196-01-0604 "Plastic anchors made of virgin or non-virgin material for fixing of external thermal insulation composite systems with rendering"

This European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

Specific Part

1 Technical description of the product

The AISC and AISDC nailed-in plastic anchors consist of a plastic expansion sleeve with a plate made of polypropylene (virgin material) and an accompanying nail as an expansion pin made of polyamide PA6 reinforced with glass fibers GF30 (virgin material).

The AISS, AISX, AISDS and AISDX nailed-in plastic anchors consist of a plastic expansion sleeve with a plate made of polypropylene (virgin material) and an accompanying nail as an expansion pin made of carbon steel with zinc coating.

The plastic anchor sleeve is expanded by hammering in a nail, which press the sleeve against the wall of the drilled hole.

The AISC, AISS, AISX, AISDC, AISDS and AISDX anchors may in addition be combined with the additional plate type AISR, made of polypropylene, polyamide PA6 or polyamide PA6 reinforced with glass fibers (virgin materials).

The drawings and the description of the products are given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document (EAD)

The performances given in clause 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The provisions made in this European Technical Assessment are based on an assumed working life of the anchor of 25 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer or Technical Assessment Body, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Performance of the product

3.1.1 Safety and accessibility in use (BWR 4)

Essential characteristic	Performance
Characteristic resistance	Annex C1
Edge distances and spacing	Annex B2
Plate stiffness	Annex C2
Displacements	Annex C3

3.1.2 Energy economy and heat retention (BWR 6)

Essential characteristic	Performance
Point thermal transmittance of an anchor	No performance assessed

3.2 Methods used for the assessment

The assessment has been made in accordance with EAD 330196-01-0604.

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

According to the Decision 97/463/EC of the European Commission the system 2+ of assessment and verification of constancy of performance (see Annex V to the regulation (EU) No 305/2011) applies.

5 Technical details necessary for the implementation of the AVCP system, as provided in the applicable European Assessment Document (EAD)


Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited in Instytut Techniki Budowlanej.

For the type testing the results of the tests performed as part of the assessment for the European Technical Assessment shall be used unless there are changes in the production line or plant. In such cases the necessary type testing has to be agreed between Instytut Techniki Budowlanej and the notified body.


Issued in Warsaw on 01/02/2022 by Instytut Techniki Budowlanej



Anna Panek, MSc
Deputy Director of ITB

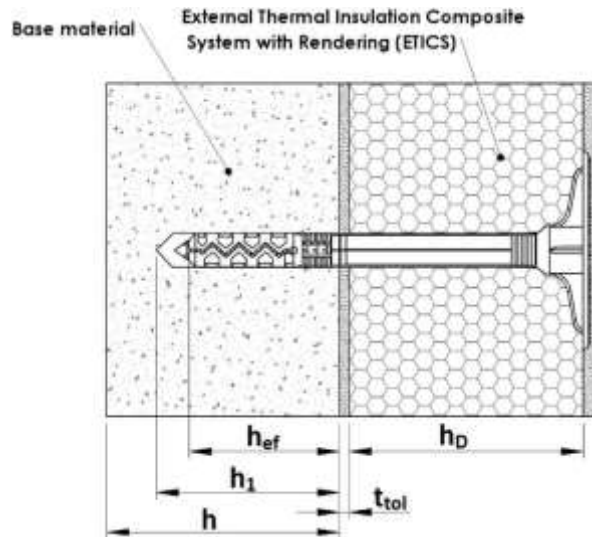

Surface assembly

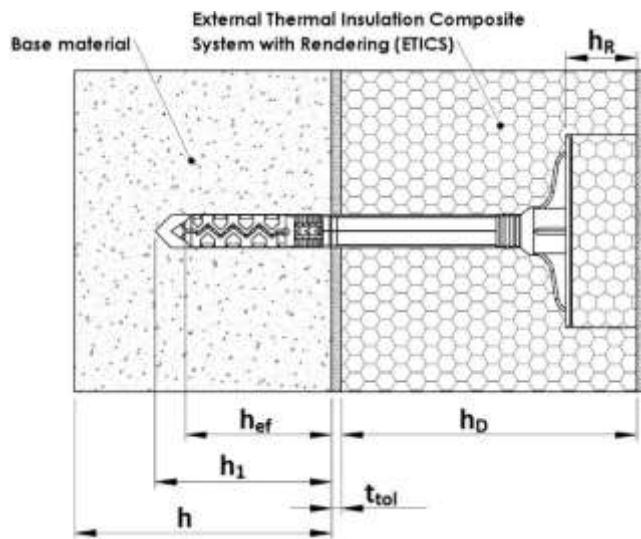

Countersunk assembly

Intended Use

Fixing of external thermal insulation composite systems in concrete and masonry

Legend

- h_{ef} = effective anchorage depth
- h_1 = depth of drill hole in base material
- h = thickness of base material
- h_D = thickness of insulation material
- t_{tol} = thickness of equalizing and/or non-load-bearing layer
- h_R = thickness of plug

AISC, AISS, AISX, AISDC, AISDS, AISDX	Annex A1 of European Technical Assessment ETA-21/0823
Product description Installation conditions	

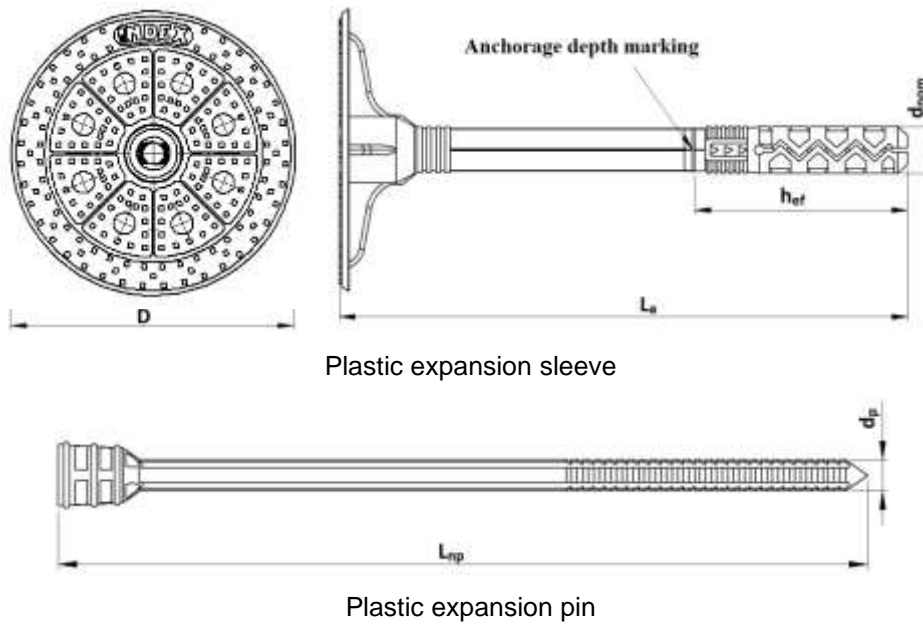


Table A1: AISC anchor types and dimensions [mm]

Anchor type	Anchor sleeve				Expansion pin	
	$d_{nom} \pm 0,1$	$L_a \pm 2$	$D +3/-1$	h_{ef}	$d_p \pm 0,1$	$L_{np} \pm 2$
AISC10070	10	70	60	50	5,7	75
AISC10090	10	90	60	50	5,7	95
AISC10100	10	100	60	50	5,7	105
AISC10120	10	120	60	50	5,7	125
AISC10140	10	140	60	50	5,7	145
AISC10160	10	160	60	50	5,7	165
AISC10180	10	180	60	50	5,7	185
AISC10200	10	200	60	50	5,7	205
AISC10220	10	220	60	50	5,7	225
AISC10260	10	260	60	50	5,7	265
AISC10300	10	300	60	50	5,7	305
AISC10350	10	350	60	50	5,7	355
AISC10400	10	400	60	50	5,7	405

Determination of maximum thickness of insulation material:


For surface assembly: $h_D = L_a - t_{tol} - h_{ef}$

For countersunk assembly: $h_D = L_a - t_{tol} - h_{ef} + h_R$

AISC, AISS, AISX, AISDC, AISDS, AISDX

Product description
Dimensions of the AISC anchor elements

Annex A2
of European
Technical Assessment
ETA-21/0823

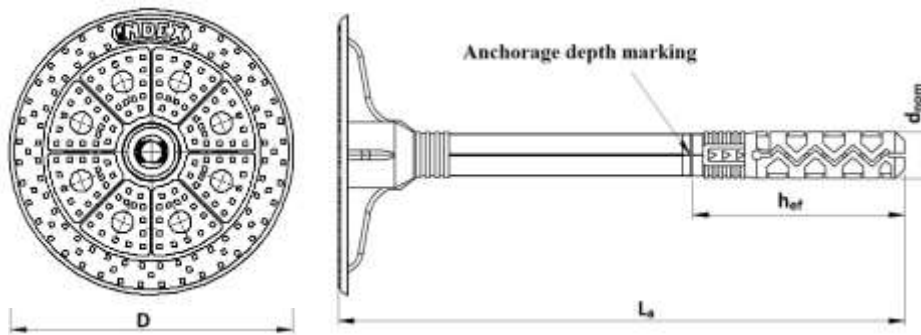

Plastic expansion sleeve



Steel expansion pin

Table A2: AISS anchor types and dimensions [mm]

Anchor type	Anchor sleeve				Expansion pin	
	$d_{nom} \pm 0,1$	$L_a \pm 2$	$D +3/-1$	h_{ef}	$d_m \pm 0,1$	$L_{nm} \pm 2$
AISS10070	10	70	60	50	5,5	75
AISS10090	10	90	60	50	5,5	95
AISS10100	10	100	60	50	5,5	105
AISS10120	10	120	60	50	5,5	125
AISS10140	10	140	60	50	5,5	145
AISS10160	10	160	60	50	5,5	165
AISS10180	10	180	60	50	5,5	185
AISS10200	10	200	60	50	5,5	205
AISS10220	10	220	60	50	5,5	225
AISS10260	10	260	60	50	5,5	265
AISS10300	10	300	60	50	5,0	305
AISS10350	10	350	60	50	5,0	355
AISS10400	10	400	60	50	5,0	405

Determination of maximum thickness of insulation material:

For surface assembly: $h_D = L_a - t_{tol} - h_{ef}$

For countersunk assembly: $h_D = L_a - t_{tol} - h_{ef} + h_R$

AISC, AISS, AISX, AISDC, AISDS, AISDX

Product description
Dimensions of the AISS anchor elements

Annex A2
of European
Technical Assessment
ETA-21/0823

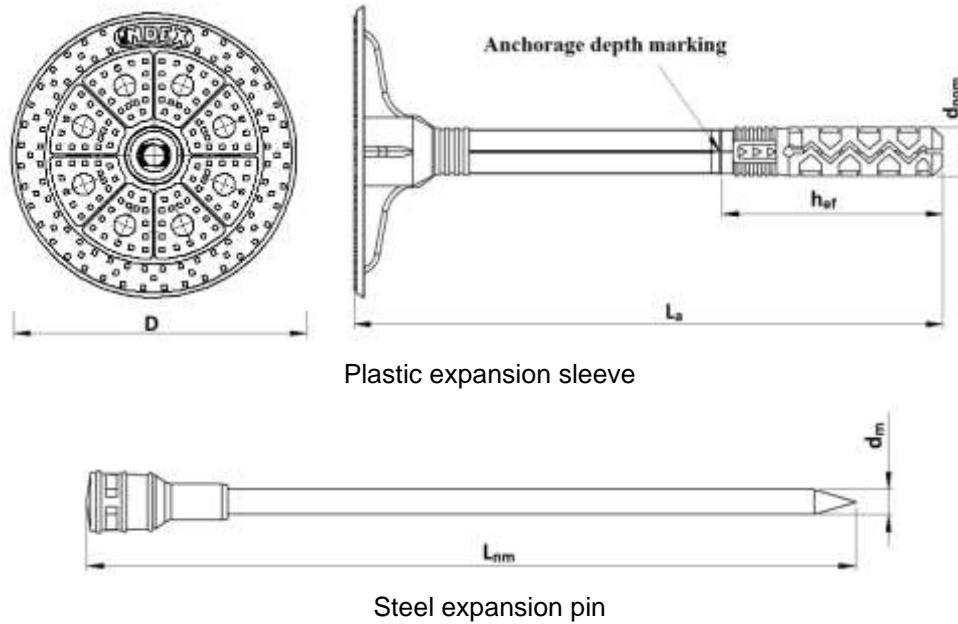


Table A3: AISX anchor types and dimensions [mm]

Anchor type	Anchor sleeve				Expansion pin	
	$d_{nom} \pm 0,1$	$L_a \pm 2$	$D +3/-1$	h_{ef}	$d_m \pm 0,1$	$L_{nm} \pm 2$
AISX10070	10	70	60	50	5,5	75
AISX10090	10	90	60	50	5,5	95
AISX10100	10	100	60	50	5,5	105
AISX10120	10	120	60	50	5,5	125
AISX10140	10	140	60	50	5,5	145
AISX10160	10	160	60	50	5,5	165
AISX10180	10	180	60	50	5,5	185
AISX10200	10	200	60	50	5,5	205
AISX10220	10	220	60	50	5,5	225
AISX10260	10	260	60	50	5,5	265
AISX10300	10	300	60	50	5,0	305
AISX10350	10	350	60	50	5,0	355
AISX10400	10	400	60	50	5,0	405

Determination of maximum thickness of insulation material:

For surface assembly: $h_D = L_a - t_{tol} - h_{ef}$

For countersunk assembly: $h_D = L_a - t_{tol} - h_{ef} + h_R$

AISC, AISS, AISX, AISDC, AISDS, AISDX

Product description
Dimensions of the AISX anchor elements

Annex A2
of European
Technical Assessment
ETA-21/0823

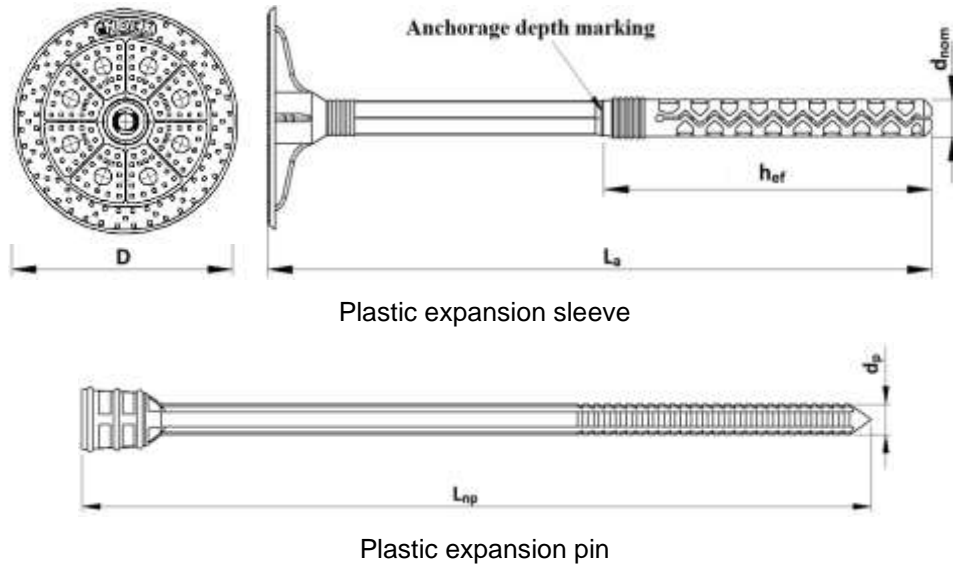


Table A4: AISDC anchor types and dimensions [mm]

Anchor type	Anchor sleeve				Expansion pin	
	$d_{nom} \pm 0,1$	$L_a \pm 2$	$D +3/-1$	h_{ef}	$d_p \pm 0,1$	$L_{np} \pm 2$
AISDC10140	10	140	60	80	5,7	145
AISDC10160	10	160	60	80	5,7	165
AISDC10180	10	180	60	80	5,7	185
AISDC10200	10	200	60	80	5,7	205
AISDC10220	10	220	60	80	5,7	225
AISDC10260	10	260	60	80	5,7	265
AISDC10300	10	300	60	80	5,7	305
AISDC10350	10	350	60	80	5,7	355
AISDC10400	10	400	60	80	5,7	405

Determination of maximum thickness of insulation material:

For surface assembly: $h_D = L_a - t_{tol} - h_{ef}$

For countersunk assembly: $h_D = L_a - t_{tol} - h_{ef} + h_R$

AISC, AISS, AISX, AISDC, AISDS, AISDX

Product description
Dimensions of the AISDC anchor elements

Annex A2
of European
Technical Assessment
ETA-21/0823

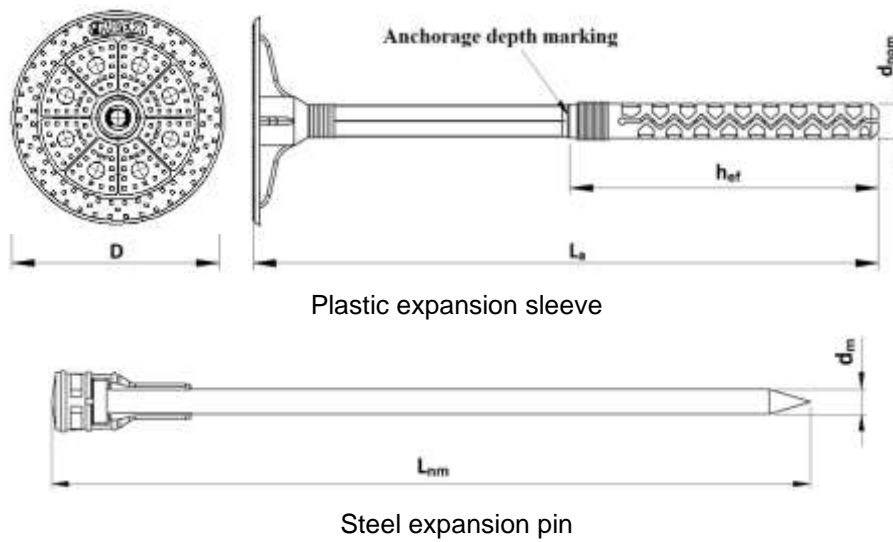


Table A5: AISDS anchor types and dimensions [mm]

Anchor type	Anchor sleeve				Expansion pin	
	$d_{nom} \pm 0,1$	$L_a \pm 2$	$D +3/-1$	h_{ef}	$d_m \pm 0,1$	$L_{nm} \pm 2$
AISDS10140	10	140	60	80	5,0	145
AISDS10160	10	160	60	80	5,0	165
AISDS10180	10	180	60	80	5,0	185
AISDS10200	10	200	60	80	5,0	205
AISDS10220	10	220	60	80	5,0	225
AISDS10260	10	260	60	80	5,0	265
AISDS10300	10	300	60	80	5,0	305
AISDS10350	10	350	60	80	5,0	355
AISDS10400	10	400	60	80	5,0	405

Determination of maximum thickness of insulation material:

For surface assembly: $h_D = L_a - t_{tol} - h_{ef}$

For countersunk assembly: $h_D = L_a - t_{tol} - h_{ef} + h_R$

AISC, AISS, AISX, AISDC, AISDS, AISDX

Product description
Dimensions of the AISDS anchor elements

Annex A2
of European
Technical Assessment
ETA-21/0823

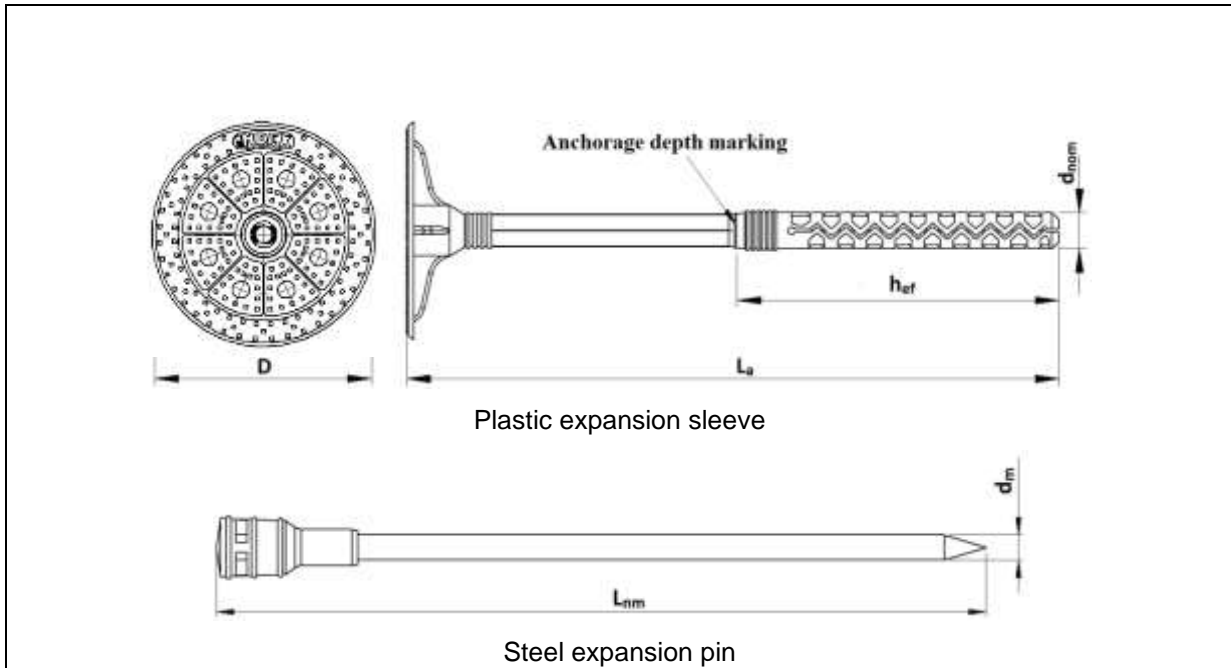


Table A6: AISDX anchor types and dimensions [mm]

Anchor type	Anchor sleeve				Expansion pin	
	$d_{nom} \pm 0,1$	$L_a \pm 2$	$D +3/-1$	h_{ef}	$d_m \pm 0,1$	$L_{nm} \pm 2$
AISDX10140	10	140	60	80	5,0	145
AISDX10160	10	160	60	80	5,0	165
AISDX10180	10	180	60	80	5,0	185
AISDX10200	10	200	60	80	5,0	205
AISDX10220	10	220	60	80	5,0	225
AISDX10260	10	260	60	80	5,0	265
AISDX10300	10	300	60	80	5,0	305
AISDX10350	10	350	60	80	5,0	355
AISDX10400	10	400	60	80	5,0	405

Determination of maximum thickness of insulation material:

For surface assembly: $h_D = L_a - t_{tol} - h_{ef}$


For countersunk assembly: $h_D = L_a - t_{tol} - h_{ef} + h_R$

AISC, AISS, AISX, AISDC, AISDS, AISDX	Annex A2 of European Technical Assessment ETA-21/0823
Product description Dimensions of the AISDX anchor elements	

Table A7: Materials

Designation		Material
Plastic expansion anchor sleeve		Polypropylene (orange / grey / white), virgin material
Plastic expansion pin Ø 5,7 mm		Polyamide PA6 (natural / grey / orange / black) reinforced with glass fibre GF30, virgin material
Steel expansion pin	Ø 5 mm	Carbon steel ($f_{y,k} \geq 490$ MPa, $f_{u,k} \geq 650$ MPa) with zinc coating ≥ 5 μm ; galvanized according to EN ISO 4042
	Ø 5,5 mm	Carbon steel ($f_{y,k} \geq 450$ MPa, $f_{u,k} \geq 600$ MPa) with zinc coating ≥ 5 μm ; galvanized according to EN ISO 4042

Marking:

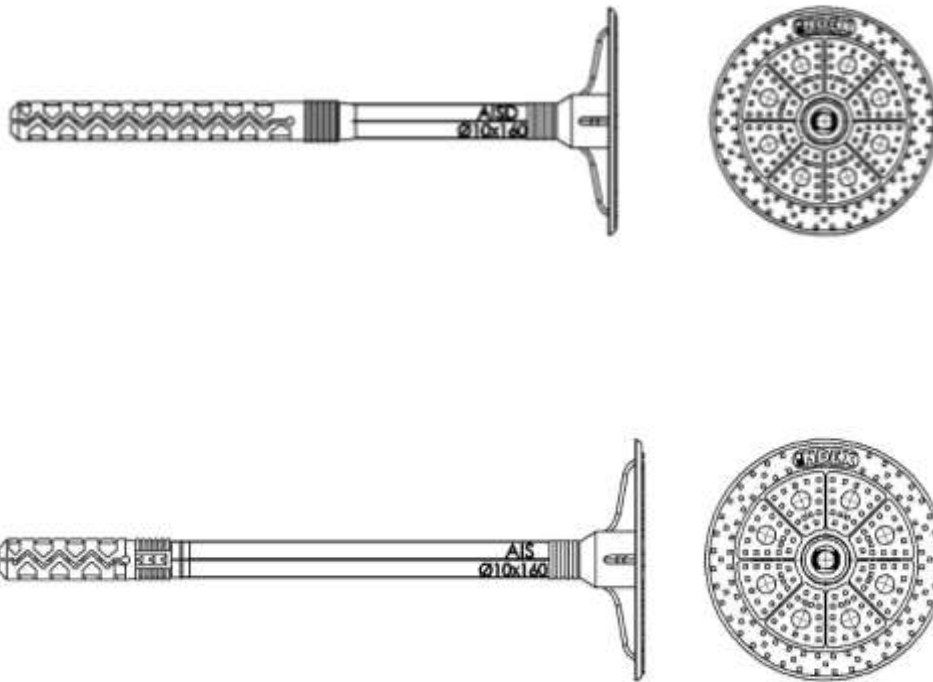

Diameter and length of anchor: e.g. $\varnothing 10 \times 160$

AISC, AISS, AISX, AISDC, AISDS, AISDX

Product description
Materials and marking

Annex A3
of European
Technical Assessment
ETA-21/0823


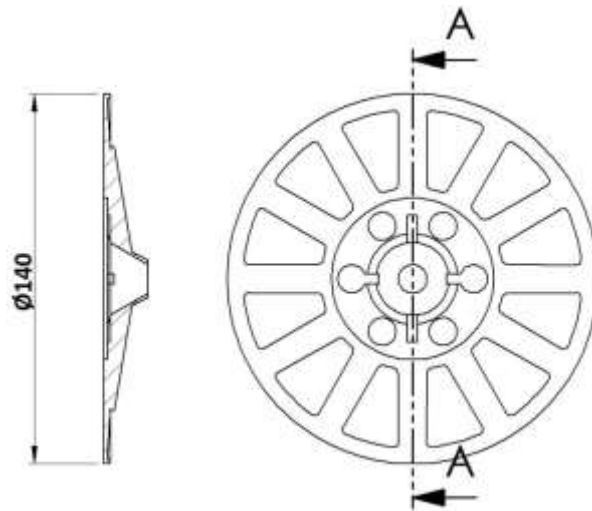



Table A8: Additional plate AISR

Plate type	Outer diameter [mm]	Material
AISR	140	Polypropylene, polyamide PA6 reinforced with glass fibre or not reinforced (orange / white / grey / natural)


Equipment for countersunk assembly

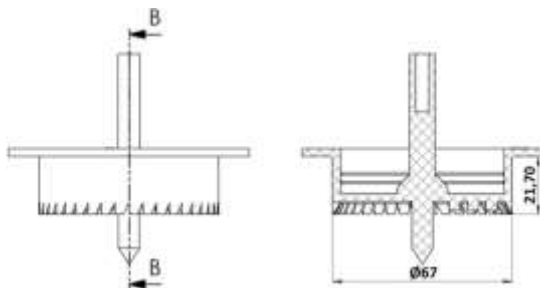


Cutter AISCS for styrofoam

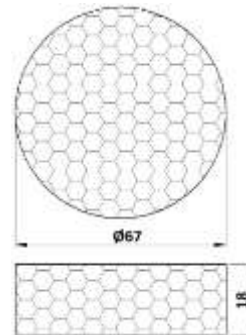

Plug AISPS made of styrofoam

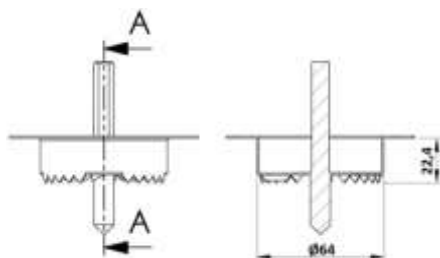

Cutter AISCW for mineral wool (MW)



Plug AISPW made of mineral wool (MW)

AISC, AISS, AISX, AISDC, AISDS, AISDX

Product description

Additional plate AISR and equipment for countersunk assembly used with AISC, AISS, AISX, AISDC, AISDS, AISDX anchors

Annex A4

of European
Technical Assessment
ETA-21/0823

Specification of intended use

Anchorage subject to:

- Wind suction loads.
 Note: The anchor shall not be used for the transmission of dead loads of the external thermal insulation composite system.

Base materials:

- Reinforced or unreinforced normal weight concrete (use category A), according to Annex C1 and C3.
- Solid masonry (use category B), according to Annex C1 and C3.
- Hollow or perforated masonry (use category C), according to Annex C1 and C3.
- Lightweight aggregate concrete (use category D), according to Annex C1 and C3.
- Autoclaved aerated concrete (use category E), according to Annex C1 and C3.
- For other base materials of the use categories A, B, C, D or E the characteristic resistance of the anchor may be determined by job site tests according to EOTA Technical Report TR 051, edition December 2016.

Application temperature range:

- 0°C to +40°C (max. short term temperature +40°C and max. long term temperature +24°C).

Design:

- The anchorages are designed under the responsibility of an engineer experienced in anchorages and masonry work with the partial safety factors $\gamma_M = 2,0$ and $\gamma_F = 1,5$, if there are no other national regulations.
- Verifiable calculation notes and drawings with anchor positions are prepared taking into account of the loads to be anchored.
- Anchors are only to be used for multiple fixings of thermal insulation composite system (ETICS), according to EAD 330196-01-0604.

Installation:

- Hole shall be drilled by the drill modes according to Annex C1.
- Anchor installation shall be carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- Installation shall be executed in temperature from 0°C to +40°C.
- Exposure to UV due to solar radiation of the anchor not protected by rendering shall not exceed 6 weeks.

AISC, AISS, AISX, AISDC, AISDS, AISDX	Annex B1 of European Technical Assessment ETA-21/0823
Intended use Specifications	


Table B1: Installation characteristics

Anchor type		AISC, AISS, AISX	AISDC, AISDS, AISDX
Nominal diameter	d_{nom} [mm]	10	10
Nominal diameter of drill bit	d_o [mm]	10	10
Cutting diameter of drill bit	d_{cut} [mm]	$\leq 10,45$	$\leq 10,45$
Depth of drill hole for base material category A, B, C, D, E	h_1 [mm]	≥ 60	≥ 90
Effective anchorage depth for base material category A, B, C, D, E	h_{ef} [mm]	≥ 50	≥ 80

Table B2: Minimum thickness of base material, anchor spacing and edge distance

Anchor type		AISC, AISS, AISX, AISDC, AISDS, AISDX
Minimum thickness of base material	h_{min} [mm]	100
Minimum spacing	s_{min} [mm]	100
Minimum edge distance	c_{min} [mm]	100

Diagram of spacing

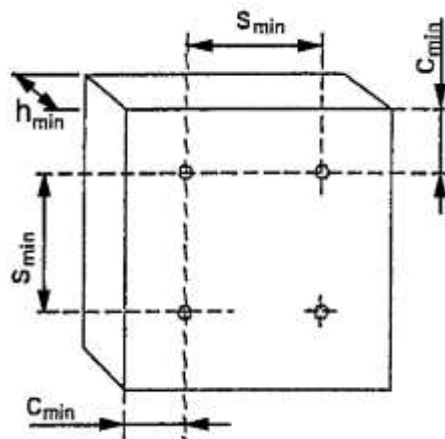


AISC, AISS, AISX, AISDC, AISDS, AISDX



Intended use
Installation characteristics, minimum thickness of base material, edge distance and spacing

Annex B2
of European
Technical Assessment
ETA-21/0823


Installation instruction – surface assembly

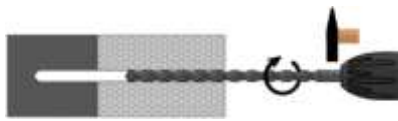


Drill perpendicular hole by corresponding method acc. to Annex C1.




or

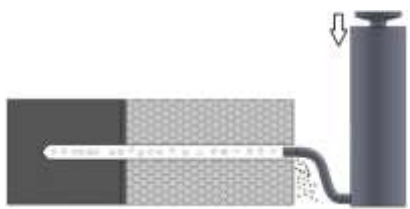



In case of installation in solid base materials clean correctly the hole by removing dust.



Set-in the anchor and make sure that the plate bottom is flush with the ETICS surface.



Nail-in the expansion pin.



Correctly installed anchor.



AISC, AISS, AISX, AISDC, AISDS, AISDX

Intended use

Installation instruction – surface assembly

Annex B3

of European
Technical Assessment
ETA-21/0823

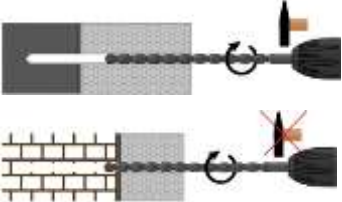
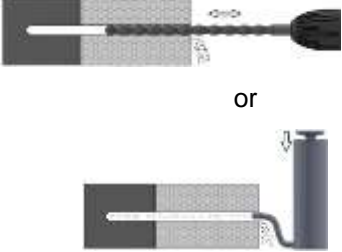


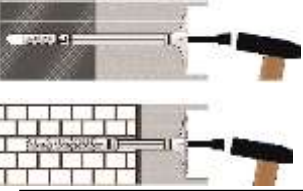


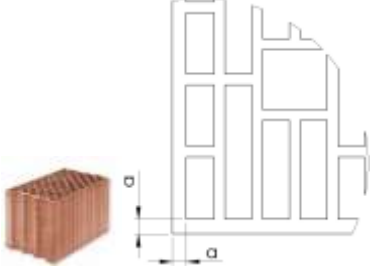
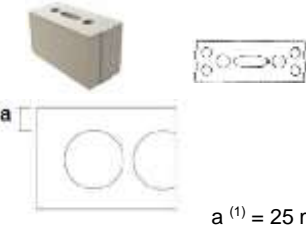

Installation instruction – countersunk assembly	
	<p>Drill perpendicular hole by corresponding method acc. to Annex C1.</p>
 <p style="text-align: center;">or</p>	<p>In case of installation in solid base materials clean correctly the hole by removing dust.</p>
	<p>Using the cutter make a hole in insulation material.</p>
	<p>Set-in the anchor and make sure that the plate bottom is flush with the ETICS surface.</p>
	<p>Nail-in the expansion pin.</p>
	<p>Set-in the plug.</p>
	<p>Correctly installed anchor.</p>
<p>AISC, AISS, AISX, AISDC, AISDS, AISDX</p>	<p>Annex B3 of European Technical Assessment ETA-21/0823</p>
<p>Intended use Installation instruction – countersunk assembly</p>	

Table C1: Characteristic resistance to tension loads N_{Rk} in concrete and in masonry for single AISC anchor




Base material	Bulk density [kg/dm ³]	Compressive strength [N/mm ²]	Referring standard	N_{Rk} [kN]	Drill method
Concrete C12/15 (use category A)			EN 206	0,55	hammer
Concrete C16/20 to C50/60 (use category A)			EN 206	0,80	hammer
Clay bricks MZ (use category B)	≥ 2,0	≥ 20,0	EN 771-1	1,00	hammer
Calcium silicate bricks KS (use category B)	≥ 2,0	≥ 20,0	EN 771-2	0,40	hammer
Vertically perforated clay bricks Porotherm 25 P+D (use category C)	≥ 0,8	≥ 15,0	EN 771-1	0,10	rotary
 $a^{(1)} = 11 \text{ mm}$					
 $a^{(1)} = 25 \text{ mm}$	≥ 1,6	≥ 15,0	EN 771-2	0,65	rotary
	≥ 0,88	≥ 5,0	EN 771-3	0,20	rotary
Partial safety factor for anchor resistance, $\gamma_M^{(2)}$	2,0				
⁽¹⁾ minimum values "a", for elements with lower value of "a" the load tests on the construction site are required ⁽²⁾ in the absence of other national regulations					

AISC, AISS, AISX, AISDC, AISDS, AISDX

Performances
Characteristic resistance

Annex C1
of European
Technical Assessment
ETA-21/0823

Table C2: Characteristic resistance to tension loads N_{Rk} in concrete and in masonry for single AISS and AISX anchors

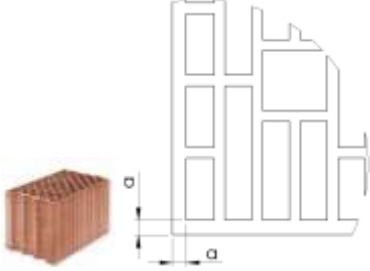
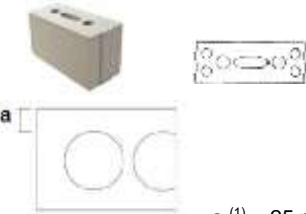

Base material	Bulk density [kg/dm ³]	Compressive strength [N/mm ²]	Referring standard	N_{Rk} [kN]	Drill method
Concrete C12/15 (use category A)			EN 206	0,40	hammer
Concrete C16/20 to C50/60 (use category A)			EN 206	0,55	hammer
Clay bricks MZ (use category B)	≥ 2,0	≥ 20,0	EN 771-1	0,65	hammer
Calcium silicate bricks KS (use category B)	≥ 2,0	≥ 20,0	EN 771-2	0,35	hammer
Vertically perforated clay bricks Porotherm 25 P+D (use category C)  a ⁽¹⁾ = 11 mm	≥ 0,8	≥ 15,0	EN 771-1	0,10	rotary
Calcium silicate hollow blocks KSL (use category C)  a ⁽¹⁾ = 25 mm	≥ 1,6	≥ 15,0	EN 771-2	0,40	rotary
Lightweight concrete blocks LAC (use category D) 	≥ 0,88	≥ 5,0	EN 771-3	0,30	rotary
Autoclaved concrete blocks AAC 2 (use category E)	≥ 0,35	≥ 2,0	EN 771-4	0,10	rotary
Partial safety factor for anchor resistance, γ_M ⁽²⁾	2,0				
⁽¹⁾ minimum values "a", for elements with lower value of "a" the load tests on the construction site are required					
⁽²⁾ in the absence of other national regulations					

AISC, AISS, AISX, AISDC, AISDS, AISDX

Performances
Characteristic resistance

Annex C1
of European
Technical Assessment
ETA-21/0823

Table C3: Characteristic resistance to tension loads N_{Rk} in concrete and in masonry for single AISDC anchor

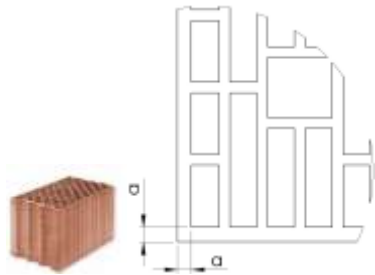
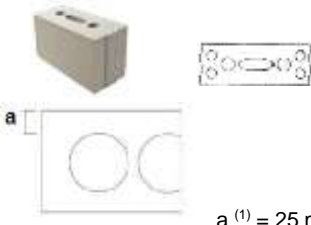

Base material	Bulk density [kg/dm ³]	Compressive strength [N/mm ²]	Referring standard	N_{Rk} [kN]	Drill method
Concrete C12/15 (use category A)			EN 206	0,30	hammer
Concrete C16/20 to C50/60 (use category A)			EN 206	0,45	hammer
Clay bricks MZ (use category B)	$\geq 2,0$	$\geq 20,0$	EN 771-1	0,45	hammer
Calcium silicate bricks KS (use category B)	$\geq 2,0$	$\geq 20,0$	EN 771-2	0,25	hammer
Vertically perforated clay bricks Porotherm 25 P+D (use category C)  $a^{(1)} = 11 \text{ mm}$	$\geq 0,8$	$\geq 15,0$	EN 771-1	0,15	rotary
Calcium silicate hollow blocks KSL (use category C)  $a^{(1)} = 25 \text{ mm}$	$\geq 1,6$	$\geq 15,0$	EN 771-2	0,15	rotary
Lightweight concrete blocks LAC (use category D) 	$\geq 0,88$	$\geq 5,0$	EN 771-3	0,15	rotary
Autoclaved concrete blocks AAC 2 (use category E)	$\geq 0,35$	$\geq 2,0$	EN 771-4	0,10	rotary
Partial safety factor for anchor resistance, $\gamma_M^{(2)}$	2,0				
⁽¹⁾ minimum values "a", for elements with lower value of "a" the load tests on the construction site are required					
⁽²⁾ in the absence of other national regulations					

AISC, AISS, AISX, AISDC, AISDS, AISDX

Performances
Characteristic resistance

Annex C1
of European
Technical Assessment
ETA-21/0823

Table C4: Characteristic resistance to tension loads N_{Rk} in concrete and in masonry for single AISDS and AISDX anchors

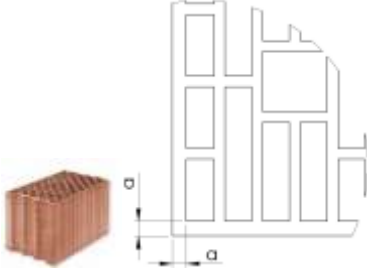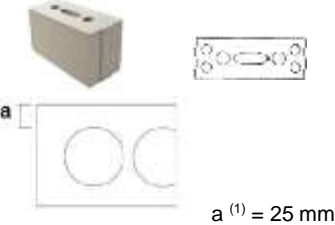Base material	Bulk density [kg/dm ³]	Compressive strength [N/mm ²]	Referring standard	N_{Rk} [kN]	Drill method
Concrete C12/15 (use category A)			EN 206	0,55	hammer
Concrete C16/20 to C50/60 (use category A)			EN 206	0,80	hammer
Clay bricks MZ (use category B)	≥ 2,0	≥ 20,0	EN 771-1	0,60	hammer
Calcium silicate bricks KS (use category B)	≥ 2,0	≥ 20,0	EN 771-2	0,65	hammer
Vertically perforated clay bricks Porothem 25 P+D (use category C)	≥ 0,8	≥ 15,0	EN 771-1	0,25	rotary
 $a^{(1)} = 11 \text{ mm}$					
Calcium silicate hollow blocks KSL (use category C)	≥ 1,6	≥ 15,0	EN 771-2	0,25	rotary
 $a^{(1)} = 25 \text{ mm}$					
Lightweight concrete blocks LAC (use category D)	≥ 0,88	≥ 5,0	EN 771-3	0,30	rotary
					
Autoclaved concrete blocks AAC 2 (use category E)	≥ 0,35	≥ 2,0	EN 771-4	0,10	rotary
Partial safety factor for anchor resistance, $\gamma_M^{(2)}$	2,0				
⁽¹⁾ minimum values "a", for elements with lower value of "a" the load tests on the construction site are required					
⁽²⁾ in the absence of other national regulations					

AISC, AISS, AISX, AISDC, AISDS, AISDX

Performances
Characteristic resistance

Annex C1
of European
Technical Assessment
ETA-21/0823

Table C5: Plate stiffness according to EOTA Technical Report TR 026




Anchor type	Diameter of the anchor plate d_{plate} [mm]	Characteristic load resistance of the anchor plate [kN]	Plate stiffness [kN/mm]
AISC, AISS, AISX, AISDC, AISDS, AISDX	60	0,84	0,20

AISC, AISS, AISX, AISDC, AISDS, AISDX

Performances
Plate stiffness

Annex C2
of European
Technical Assessment
ETA-21/0823




Table C6: Displacement of AISC anchors

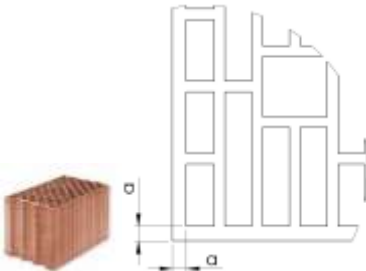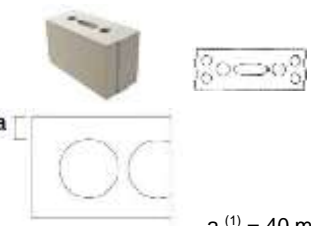Base material	Bulk density [kg/dm ³]	Compressive strength [N/mm ²]	$\frac{N_{Rk}}{3}$ [kN]	$\delta\left(\frac{N_{Rk}}{3}\right)$ [mm]
Concrete C12/15 (use category A)			0,18	0,40
Concrete C16/20 to C50/60 (use category A)			0,27	0,70
Clay bricks MZ (use category B)	≥ 2,0	≥ 20,0	0,33	1,00
Calcium silicate bricks KS (use category B)	≥ 2,0	≥ 20,0	0,13	0,42
Vertically perforated clay bricks Porotherm 25 P+D (use category C)  a ⁽¹⁾ = 11 mm	≥ 0,8	≥ 15,0	0,03	0,09
Calcium silicate hollow blocks KSL (use category C)  a ⁽¹⁾ = 40 mm	≥ 1,6	≥ 12,0	0,22	0,88
Lightweight concrete blocks LAC (use category D) 	≥ 0,88	≥ 5,0	0,06	0,13
⁽¹⁾ minimum values "a", for elements with lower value of "a" the load tests on the construction site are required				

AISC, AISS, AISX, AISDC, AISDS, AISDX

Performances
DisplacementAnnex C3
of European
Technical Assessment
ETA-21/0823

Table C7: Displacement of AISS and AISX anchors

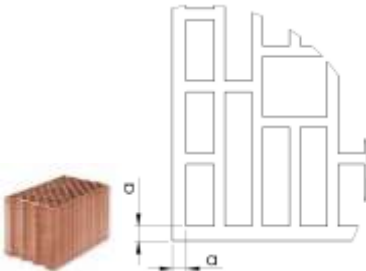
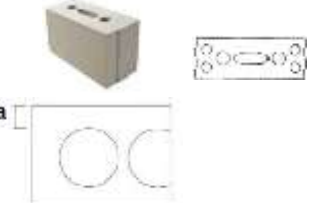

Base material	Bulk density [kg/dm ³]	Compressive strength [N/mm ²]	$\frac{N_{Rk}}{3}$ [kN]	$\delta\left(\frac{N_{Rk}}{3}\right)$ [mm]
Concrete C12/15 (use category A)			0,13	0,40
Concrete C16/20 to C50/60 (use category A)			0,18	0,70
Clay bricks MZ (use category B)	≥ 2,0	≥ 20,0	0,22	0,90
Calcium silicate bricks KS (use category B)	≥ 2,0	≥ 20,0	0,12	0,57
Vertically perforated clay bricks Porotherm 25 P+D (use category C)	≥ 0,8	≥ 15,0	0,03	0,13
 a ⁽¹⁾ = 11 mm				
Calcium silicate hollow blocks KSL (use category C)	≥ 1,6	≥ 12,0	0,13	0,70
 a ⁽¹⁾ = 40 mm				
Lightweight concrete blocks LAC (use category D)	≥ 0,88	≥ 5,0	0,10	0,45
				
Autoclaved concrete blocks AAC 2 (use category E)	≥ 0,35	≥ 2,0	0,03	0,08
⁽¹⁾ minimum values "a", for elements with lower value of "a" the load tests on the construction site are required				

AISC, AISS, AISX, AISDC, AISDS, AISDX

**Performances
Displacement**

Annex C3
of European
Technical Assessment
ETA-21/0823




Table C8: Displacement of AISDC anchor

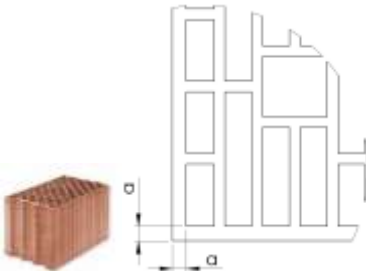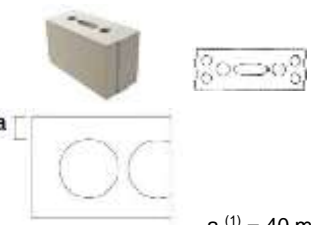Base material	Bulk density [kg/dm ³]	Compressive strength [N/mm ²]	$\frac{N_{Rk}}{3}$ [kN]	$\delta\left(\frac{N_{Rk}}{3}\right)$ [mm]
Concrete C12/15 (use category A)			0,10	0,32
Concrete C16/20 to C50/60 (use category A)			0,15	0,34
Clay bricks MZ (use category B)	≥ 2,0	≥ 20,0	0,15	0,36
Calcium silicate bricks KS (use category B)	≥ 2,0	≥ 20,0	0,08	0,10
Vertically perforated clay bricks Porotherm 25 P+D (use category C)  a ⁽¹⁾ = 11 mm	≥ 0,8	≥ 15,0	0,05	0,06
Calcium silicate hollow blocks KSL (use category C)  a ⁽¹⁾ = 40 mm	≥ 1,6	≥ 12,0	0,05	0,08
Lightweight concrete blocks LAC (use category D) 	≥ 0,88	≥ 5,0	0,05	0,07
Autoclaved concrete blocks AAC 2 (use category E)	≥ 0,35	≥ 2,0	0,03	0,05
⁽¹⁾ minimum values "a", for elements with lower value of "a" the load tests on the construction site are required				

AISC, AISS, AISX, AISDC, AISDS, AISDX

Performances
DisplacementAnnex C3
of European
Technical Assessment
ETA-21/0823

Table C9: Displacement of AISDS and AISDX anchors

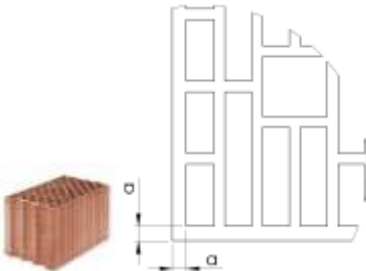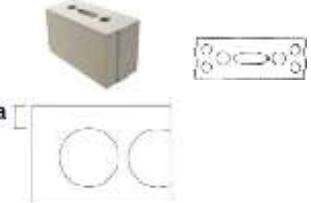Base material	Bulk density [kg/dm ³]	Compressive strength [N/mm ²]	$\frac{N_{Rk}}{3}$ [kN]	$\delta\left(\frac{N_{Rk}}{3}\right)$ [mm]
Concrete C12/15 (use category A)			0,18	0,47
Concrete C16/20 to C50/60 (use category A)			0,27	0,70
Clay bricks MZ (use category B)	≥ 2,0	≥ 20,0	0,20	0,77
Calcium silicate bricks KS (use category B)	≥ 2,0	≥ 20,0	0,22	0,70
Vertically perforated clay bricks Porotherm 25 P+D (use category C)	≥ 0,8	≥ 15,0	0,08	0,14
 a ⁽¹⁾ = 11 mm				
Calcium silicate hollow blocks KSL (use category C)	≥ 1,6	≥ 12,0	0,08	0,25
 a ⁽¹⁾ = 40 mm				
Lightweight concrete blocks LAC (use category D)	≥ 0,88	≥ 5,0	0,10	0,31
				
Autoclaved concrete blocks AAC 2 (use category E)	≥ 0,35	≥ 2,0	0,03	0,04
⁽¹⁾ minimum values "a", for elements with lower value of "a" the load tests on the construction site are required				

AISC, AISS, AISX, AISDC, AISDS, AISDX

**Performances
Displacement**

Annex C3
of European
Technical Assessment
ETA-21/0823